


SMOKE ALARMS ARE REQUIRED TO BE HARD WIRED BATTERY BACKUP INTERCONNECTED IN SLEEPING AREAS, HALLS AND ON EACH LEVEL

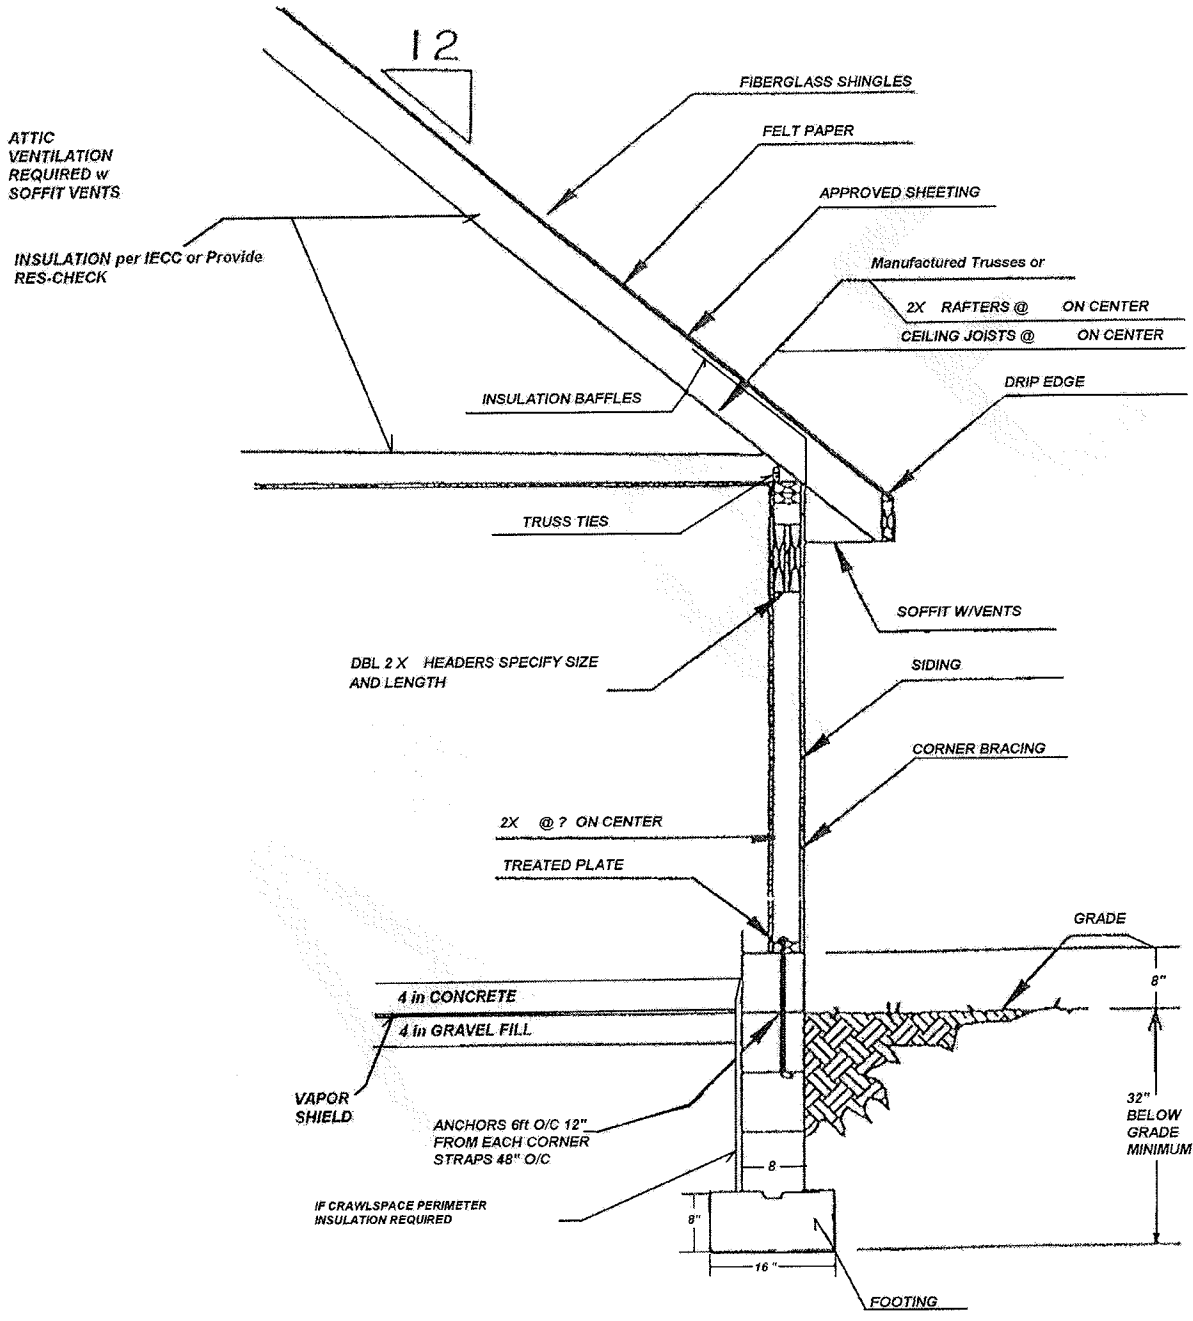

ATTIC VENTILATION REQUIRED w SOFFIT VENTS

INSULATION per IECC or Provide RES-CHECK

DBL 2 X HEADERS SPECIFY SIZE AND LENGTH

VAPOR SHIELD

IF CRAWLSPACE PERIMETER INSULATION REQUIRED

SECTIONAL VIEW